

# EMC Test Report

Applicant: Shanghai Elecnova Energy Storage Co., Ltd.

Product: Energy Storage System

Model: ECO-E64WX

In accordance with EN IEC 61000-6-2,  
EN IEC 61000-6-4



**Add value.  
Inspire trust.**

Prepared for: Shanghai Elecnova Energy Storage Co., Ltd.  
T1-3F, Hongqiao Hui No. 990 Shenchang Road, Minhang District  
214400 Shanghai PEOPLE'S REPUBLIC OF CHINA

## COMMERCIAL-IN-CONFIDENCE

Report Number: 4840824422800

RESPONSIBLE FOR	NAME	SIGNATURE	DATE
Approved By	Dingpeng Xia		2024.12.25
Prepared By	Jin Cai		2024.12.25

Signatures in this approval box have checked this document in line with the requirements of TÜV SÜD Product Service document control rules.

### EXECUTIVE SUMMARY

A sample of this product was tested and found to be compliant with EN IEC 61000-6-2:2019,  
EN IEC 61000-6-4:2019.

### DISCLAIMER AND COPYRIGHT

This non-binding report has been prepared by TÜV SÜD Product Service with all reasonable skill and care. The reports apply only to the specific samples tested under stated test conditions. The document is confidential to the potential Client and TÜV SÜD Product Service. No part of this document may be reproduced without the prior written approval of TÜV SÜD Product Service.

TÜV SÜD Certification and Testing  
(China) Co., Ltd.

Floor 1-4, Building B, No.37, Tuanjie  
Road(Middle), Xishan Economic and  
Technological Development Zone,  
Wuxi, Jiangsu, China

Phone: +86 510 8820 3737  
Fax: +86 510 8820 3636

ID Number: EMC\_WUX\_F\_25.43E  
Revision:04  
Effective:2023-07-11



## Contents

<b>1</b>	<b>Report Summary .....</b>	<b>3</b>
1.1	Report Modification Record.....	3
1.2	Introduction.....	3
1.3	Brief Summary of Results .....	4
1.4	Product Information .....	5
1.5	Deviations from the Standard.....	6
1.6	Test Location.....	6
<b>2</b>	<b>Test Details .....</b>	<b>7</b>
2.1	Emission - Enclosure port .....	7
2.2	Emission - Conducted Disturbance.....	14
2.3	Immunity - Enclosure port - Electrostatic discharge.....	25
2.4	Immunity - Enclosure port - Radio-frequency electromagnetic field. Amplitude modulated .....	28
2.5	Immunity - Enclosure port - Power-frequency magnetic field .....	31
2.6	Immunity - Fast transients.....	34
2.7	Immunity - Surges .....	37
2.8	Immunity - Radio-frequency common mode .....	40
2.9	Immunity - Voltage dips, short interruptions and voltage variations immunity tests .....	43
<b>3</b>	<b>Test Equipment Information .....</b>	<b>46</b>
3.1	General Test Equipment Used.....	46
<b>4</b>	<b>Measurement Uncertainty .....</b>	<b>48</b>
<b>5</b>	<b>Photographs .....</b>	<b>49</b>



# 1 Report Summary

## 1.1 Report Modification Record

Alterations and additions to this report will be issued to the holders of each copy in the form of a complete document.

Issue	Description of Change	Date of Issue
1	First Issue	2024.12.25

## 1.2 Introduction

The information contained in this report is intended to show verification of the EMC Qualification Approval Testing of the requirements of the standards for the tests listed in Section 1.3.

Applicant	Shanghai Elecnova Energy Storage Co., Ltd.
Address	T1-3F, Hongqiao Hui No. 990 Shenchang Road, Minhang District 214400 Shanghai PEOPLE'S REPUBLIC OF CHINA
Manufacturer	Shanghai Elecnova Energy Storage Co., Ltd.
Address	T1-3F, Hongqiao Hui No. 990 Shenchang Road, Minhang District 214400 Shanghai PEOPLE'S REPUBLIC OF CHINA
Model	ECO-E64WX
Parameters	Rated Voltage: DC 537.6V
	Rated Capacity: 120Ah
	Auxiliary Voltage: 1/N/PE, AC 230V
	Auxiliary Current: AC 15A Max Auxiliary Frequency:50/60Hz
Sample(s) Tested	ECO-E64WX
Test Specification	EN IEC 61000-6-2:2019, EN IEC 61000-6-4:2019.
Date of Receipt of EUT	2024.12.10
Start of Test	2024.12.10
Finish of Test	2024.12.13
Name of Engineer(s)	Jin Cai

### 1.3 Brief Summary of Results

A brief summary of the tests carried out in accordance with EN IEC 61000-6-2, EN IEC 61000-6-4.

Section	Specification	Clause	Test Description	Result	Comments/Base Standard
Power on					
2.1	EN IEC 61000-6-4:2019	9 Table 3, 3.1,	Emission - Enclosure Port	Pass	--
2.2	EN IEC 61000-6-4:2019	9 Table 4, 4.1,	Emission - Conducted Disturbance	Pass	--
2.3	EN IEC 61000-6-2:2019	9 Table 1, 1.4,	Immunity - Enclosure Port - Electrostatic Discharge	Pass	IEC 61000-4-2
2.4	EN IEC 61000-6-2:2019	9 Table 1, 1.2,1.3	Immunity - Enclosure ports - Radio-frequency electromagnetic field. Amplitude modulated	Pass	IEC 61000-4-3
2.5	EN IEC 61000-6-2:2019	9 Table 1, 1.1	Immunity - Enclosure ports - Power-frequency magnetic field	Pass	IEC 61000-4-8
2.6	EN IEC 61000-6-2:2019	9 Table 4, 4.5	Immunity - Fast transients	Pass	IEC 61000-4-4
2.7	EN IEC 61000-6-2:2019	9 Table 4, 4.4	Immunity - Surges	Pass	IEC 61000-4-5
2.8	EN IEC 61000-6-2:2019	9 Table 4 4.1	Immunity - Radio-frequency common mode	Pass	IEC 61000-4-6
2.9	EN IEC 61000-6-2:2019	9 Table 4 4.2, 4.3	Voltage dips, short interruptions and voltage variations immunity tests	Pass	IEC 61000-4-11



**1.4 Product Information**

**1.4.1 Technical Description**

The Equipment Under Test (EUT) is Energy Storage System.

**1.4.2 EUT Port/Cable Identification**

Port	Max Cable Length specified	Usage	Type	Screened
DC Main power port	--	Main power	--	No
AC Auxiliary power port	--	auxiliary power	L, N, PE	No

**1.4.3 Test Configuration**

Configuration	Description
1	Power on, normal working, with EMI filter and Magnet Ring. Keep EUT monitoring and data running continual, by process control

**1.4.4 Modes of Operation**

Mode	Description
1	discharge mode: Keep EUT monitoring and data running continual, by software.
2	charging mode: Keep EUT monitoring and data running continual, by notebook software

**1.4.5 Monitoring of Performance**

The EUT works normally. Keep EUT monitoring and data running continual, by process control.



**1.4.6 Performance Criteria**

Performance criterion A: The apparatus shall continue to operate as intended during and after the test. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and from what the user may reasonable expect from the apparatus if used as intended.

Performance criterion B: The apparatus shall continue to operate as intended after the test. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended. During the test, degradation of performance is allowed, however no change of actual operating state or stored data is allowed to persist after test. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and from what the user may reasonable expect from the apparatus if used as intended.

Performance criterion C: Temporary loss of function is allowed, provided the function is self-recoverable or can be restored by the operation of the controls.

**1.5 Deviations from the Standard**

No deviations from the applicable test standard were made during testing.

**1.6 Test Location**

Suzhou Institute of Product Quality Supervision and Inspection.

Address: No.6, Xiexing Road, Caohu Street, Xiangcheng District, Suzhou, Jiangsu, China.

Test Name	Name of Engineer(s)
Emission - Enclosure port	Jin Cai
Emission - Conducted Disturbance	Jin Cai
Immunity - Enclosure ports - Electrostatic Discharge	Jin Cai
Immunity - Enclosure ports - Radio-frequency electromagnetic field. Amplitude modulated	Jin Cai
Immunity - Enclosure ports - Power-frequency magnetic field	Jin Cai
Immunity - Fast transients	Jin Cai
Immunity - Surges	Jin Cai
Immunity - Radio-frequency common mode	Jin Cai
Immunity - Voltage dips, short interruptions and voltage variations immunity tests	Jin Cai

## 2 Test Details

### 2.1 Emission - Enclosure port

#### 2.1.1 Specification Reference

EN IEC 61000-6-4:2019, Clause 9 Table 3, 3.1,

#### 2.1.2 Equipment Under Test

ECO-E64WX


#### 2.1.3 Date of Test

2024.12.10

#### 2.1.4 Test Method

The EUT was set up in a semi-anechoic chamber on a remotely controlled turntable and placed on a non-conductive support 0.1m above a reference ground plane.

A prescan of the EUT emissions profile was made while varying the antenna-to-EUT azimuth and antenna-to-EUT polarization using a peak detector; measurements were taken at a 10m distance. Using the prescan list of the highest emissions detected, their bearing and associated antenna polarization, the EUT was then formally measured using Quasi-Peak and Average detectors, as appropriate. The readings were maximized by adjusting the antenna height, polarization and turntable azimuth, in accordance with the specification

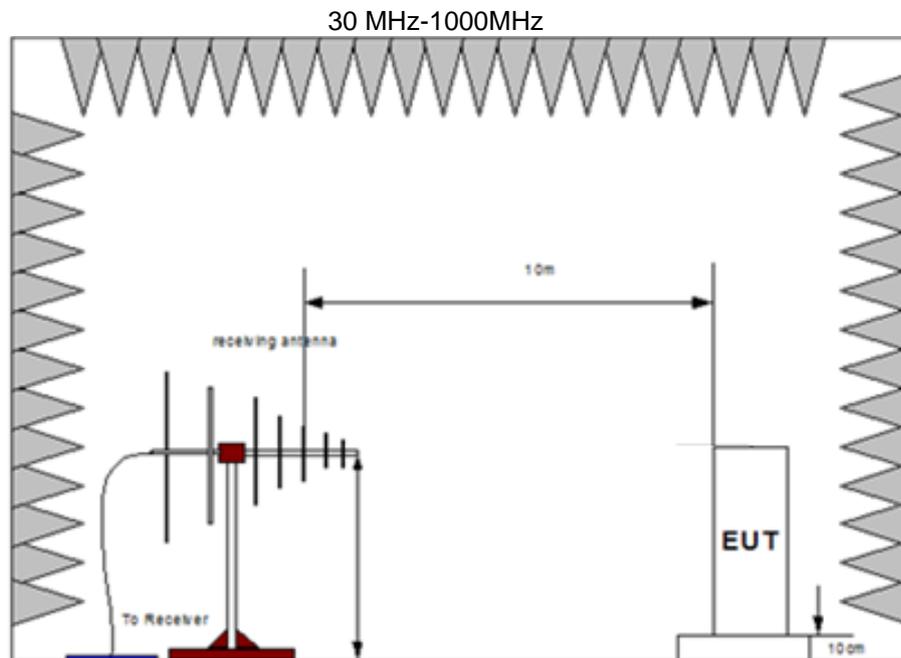



**2.1.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.1.6 Specification Limits**

Port	Frequency range	Limits	Remarks
Enclosure Test facility: OATS or SAC	30 MHz to 230 MHz 230 MHz to 1000 MHz	40 dB(µV/m) quasi-peak at 10 m 47 dB(µV/m) quasi-peak at 10 m	May be measured at 3 m distance using the limits increased by 10 dB.
Enclosure Test facility: OATS, SAC or FAR	1 GHz to 3 GHz	76 dB(µV/m) peak at 3 m 56 dB(µV/m) average at 3 m	May be measured at greater distance with the limits decreased by 20 dB/decade (relative to distance)
	3 GHz to 6 GHz	80 dB(µV/m) peak at 3 m 60 dB(µV/m) average at 3 m	
<p><b>NOTE:</b>                      For apparatus containing devices operating at frequencies less than 9 kHz measurements only need to be performed up to 230 MHz.</p> <p>If the highest internal frequency of the EUT is less than 108 MHz, the measurement shall only be made up to 1 GHz.                      If the highest internal frequency of the EUT is between 108 MHz and 500 MHz, the measurement shall only be made up to 2 GHz.                      If the highest internal frequency of the EUT is between 500 MHz and 1 GHz, the measurement shall only be made up to 5 GHz.                      If the highest internal frequency of the EUT is above 1 GHz, the measurement shall be made up to 6 GHz.</p> <p>Where the highest internal frequency if not known, tests shall be performed up to 6 GHz.</p> <p>At transitional frequencies the lower limit applies.</p>			

**2.1.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode1, 2

Performance assessment of the EUT made during this test: Pass.


Detailed results are shown below.

The highest internal frequency of the EUT is less than 108 MHz, the measurement shall only be made up to 1 GHz.



### Common Information

Test Description: 30-1000MHz Radiated Emission  
 EUT: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 1  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: Horizontal,

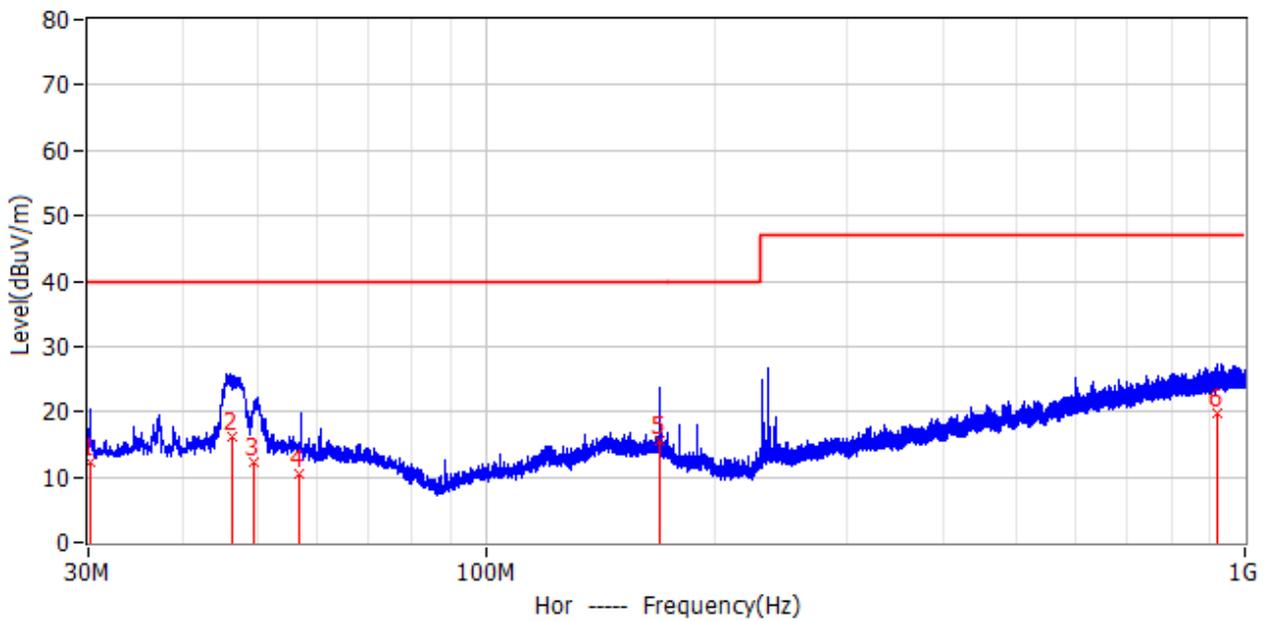


No.	Frequency	Limit dBuV/m	Level dBuV/m	Delta dB	Reading dBuV	Factor dB/m	Detector	Polar	Height cm	Angle deg
1	30.258MHz	40.0	12.3	27.7	23.4	-11.1	QP	Hor	400.0	124.0
2	46.511MHz	40.0	16.2	23.8	26.2	-10.0	QP	Hor	400.0	153.0
3	49.551MHz	40.0	12.2	27.8	22.3	-10.1	QP	Hor	200.0	241.0
4	56.700MHz	40.0	10.5	29.5	21.0	-10.5	QP	Hor	400.0	333.0
5	169.993MHz	40.0	15.5	24.5	26.5	-11.0	QP	Hor	100.0	301.0
6	917.249MHz	47.0	19.8	27.2	18.6	1.2	QP	Hor	100.0	271.0



### Common Information

Test Description:	30-1000MHz Radiated Emission
EUT:	Energy Storage System
Model:	ECO-E64WX
Client:	Shanghai Elecnova Energy Storage Co., Ltd.
Operating Conditions:	Power on, Mode 1
Operator Name:	Jin Cai
Test Standard:	EN IEC 61000-6-4
Comment:	Vertical

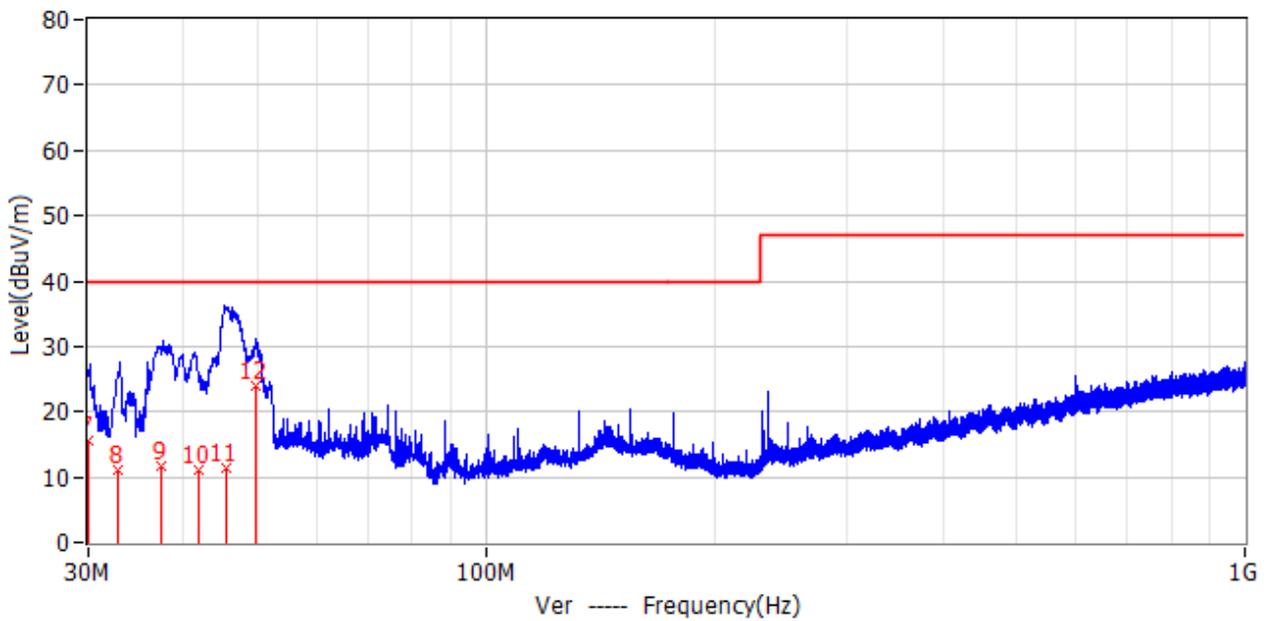


No.	Frequency	Limit dBuV/m	Level dBuV/m	Delta dB	Reading dBuV	Factor dB/m	Detector	Polar	Height cm	Angle deg
7	30.027MHz	40.0	15.5	24.5	26.7	-11.2	QP	Ver	400.0	129.0
8	32.807MHz	40.0	11.1	28.9	21.6	-10.5	QP	Ver	100.0	182.0
9	37.314MHz	40.0	11.6	28.4	21.8	-10.2	QP	Ver	400.0	233.0
10	41.817MHz	40.0	11.1	28.9	21.3	-10.2	QP	Ver	100.0	149.0
11	45.552MHz	40.0	11.5	28.5	21.6	-10.1	QP	Ver	100.0	153.0
12	49.994MHz	40.0	24.0	16.0	34.1	-10.1	QP	Ver	100.0	251.0



### Common Information

Test Description: 30-1000MHz Radiated Emission  
 EUT: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 2  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: Horizontal,

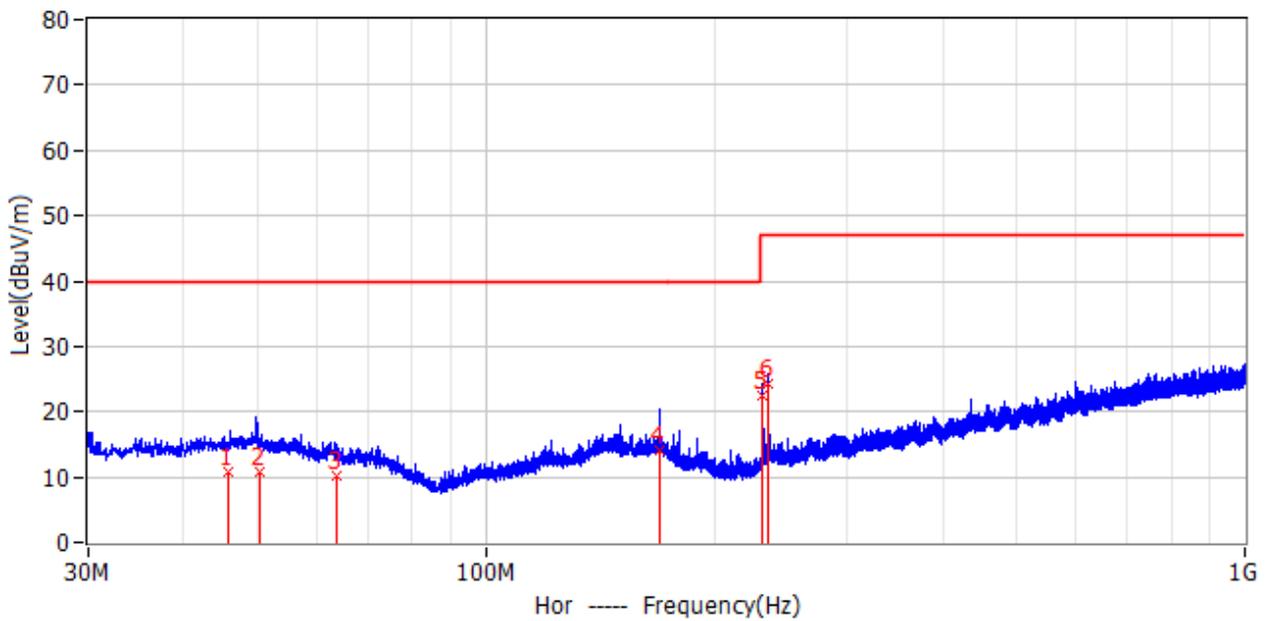


No.	Frequency	Limit dBuV/m	Level dBuV/m	Delta dB	Reading dBuV	Factor dB/m	Detector	Polar	Height cm	Angle deg
1	45.823MHz	40.0	10.8	29.2	20.8	-10.0	QP	Hor	200.0	14.0
2	50.394MHz	40.0	10.7	29.3	20.8	-10.1	QP	Hor	100.0	332.0
3	63.624MHz	40.0	10.1	29.9	21.4	-11.3	QP	Hor	300.0	40.0
4	169.845MHz	40.0	14.0	26.0	24.9	-10.9	QP	Hor	300.0	198.0
5	232.008MHz	47.0	22.5	24.5	34.9	-12.4	QP	Hor	400.0	14.0
6	235.986MHz	47.0	24.2	22.8	36.2	-12.0	QP	Hor	400.0	24.0




### Common Information

Test Description:	30-1000MHz Radiated Emission
EUT:	Energy Storage System
Model:	ECO-E64WX
Client:	Shanghai Elecnova Energy Storage Co., Ltd.
Operating Conditions:	Power on, Mode 2
Operator Name:	Jin Cai
Test Standard:	EN IEC 61000-6-4
Comment:	Vertical

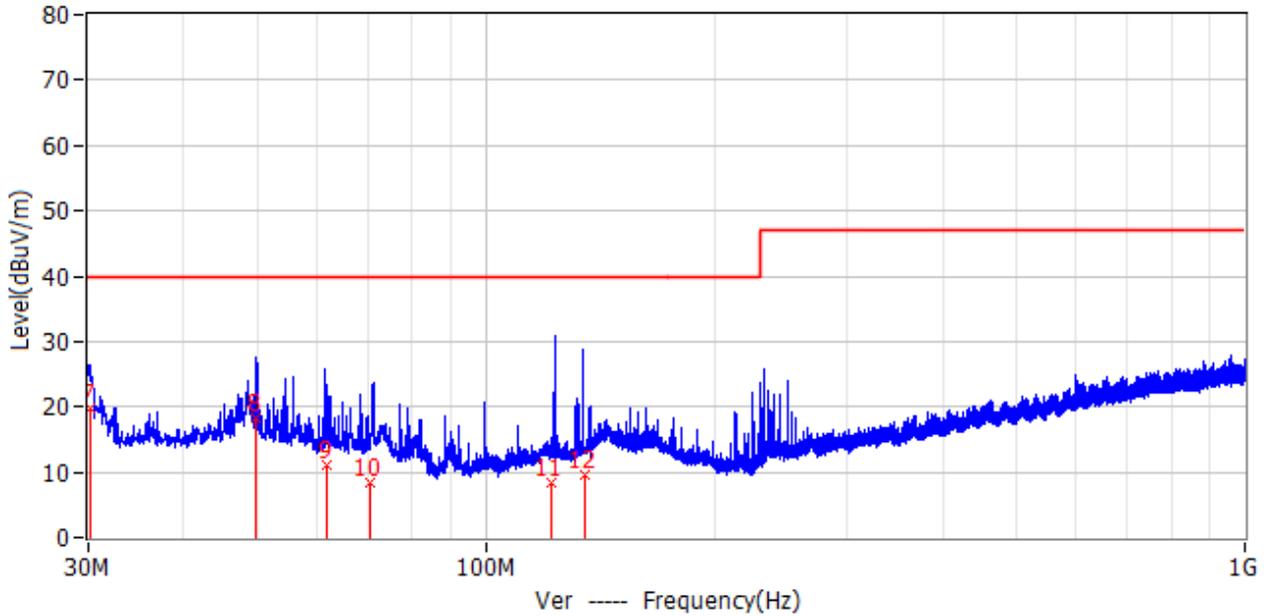

No.	Frequency	Limit dBuV/m	Level dBuV/m	Delta dB	Reading dBuV	Factor dB/m	Detector	Polar	Height cm	Angle deg
7	30.096MHz	40.0	19.8	20.2	30.9	-11.1	QP	Ver	100.0	166.0
8	49.921MHz	40.0	18.3	21.7	28.4	-10.1	QP	Ver	100.0	3.0
9	61.682MHz	40.0	11.2	28.8	22.3	-11.1	QP	Ver	100.0	354.0
10	70.556MHz	40.0	8.3	31.7	21.0	-12.7	QP	Ver	100.0	65.0
11	122.188MHz	40.0	8.3	31.7	20.8	-12.5	QP	Ver	200.0	189.0
12	135.390MHz	40.0	9.5	30.5	20.7	-11.2	QP	Ver	200.0	163.0

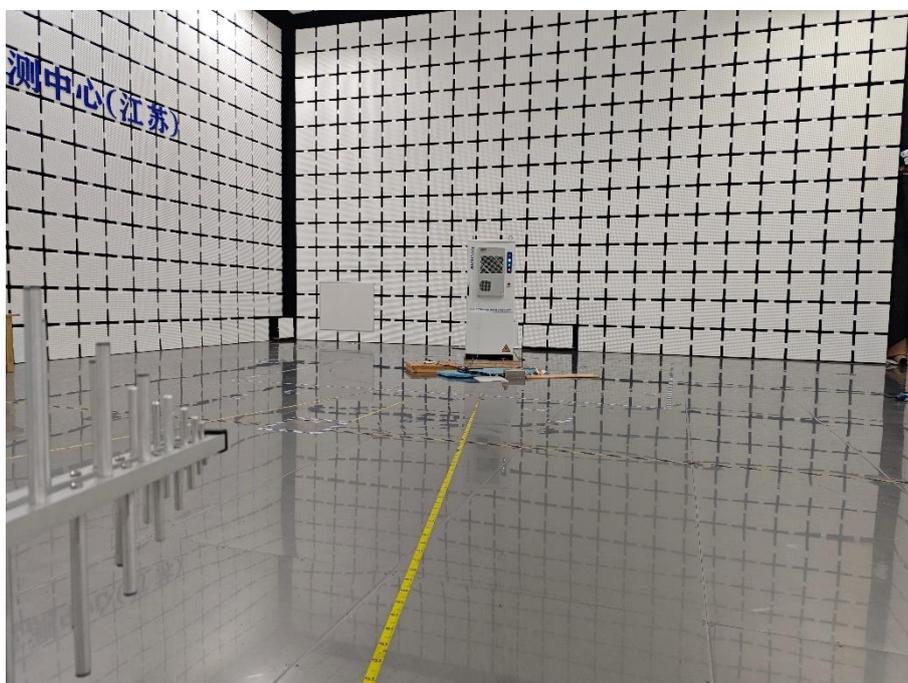

**Test Setup**

### **2.1.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

## 2.2 Emission - Conducted Disturbance

### 2.2.1 Specification Reference

EN IEC 61000-6-4:2019, Clause 9 Table 4, 4.1

### 2.2.2 Equipment Under Test


ECO-E64WX

### 2.2.3 Date of Test

2024.12.11

### 2.2.4 Test Method

The EUT was placed on a non-conductive support 0.1 m above a reference ground plane. All power was connected to the EUT through an Artificial Mains Network (AMN). Conducted disturbance voltage measurements on mains lines were made at the output of the AMN. The AMN was placed 0.8 m from the boundary of the EUT and bonded to the reference ground plane.

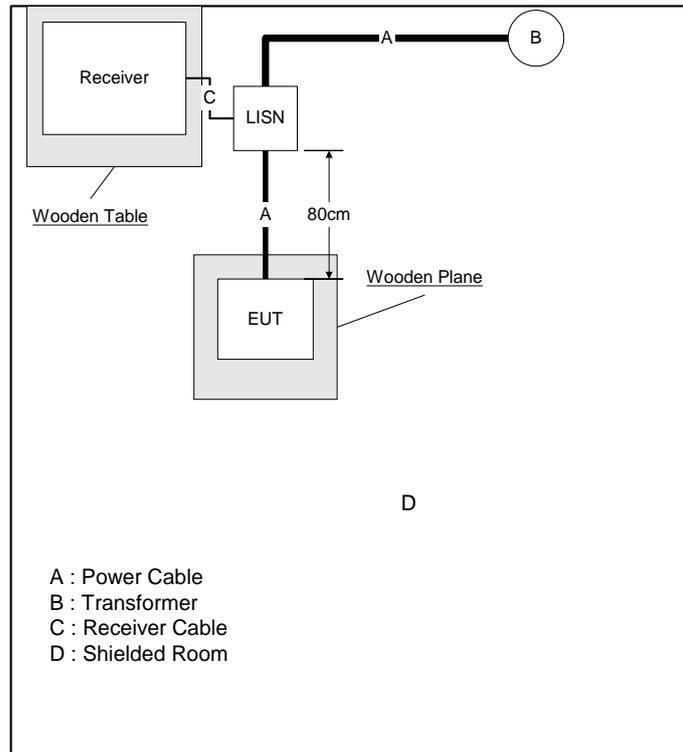



**2.2.5 Environmental Conditions**

Ambient Temperature 21.2 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.2.6 Specification Limits**

Port	Frequency range	Limits	Remarks
DC Power	0.15 MHz to 0.5 MHz	89 dB(μV) quasi-peak 76 dB(μV) average	-
	0.5 MHz to 30 MHz	83 dB(μV) quasi-peak 70 dB(μV) average	-
AC Power	0.15 MHz to 0.5 MHz	79 dB(μV) quasi-peak 66 dB(μV) average	-
	0.5 MHz to 30 MHz	73 dB(μV) quasi-peak 60 dB(μV) average	-

a\*: At transitional frequencies the lower limit applies.

**2.2.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode1, 2.


Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 1  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: DC +

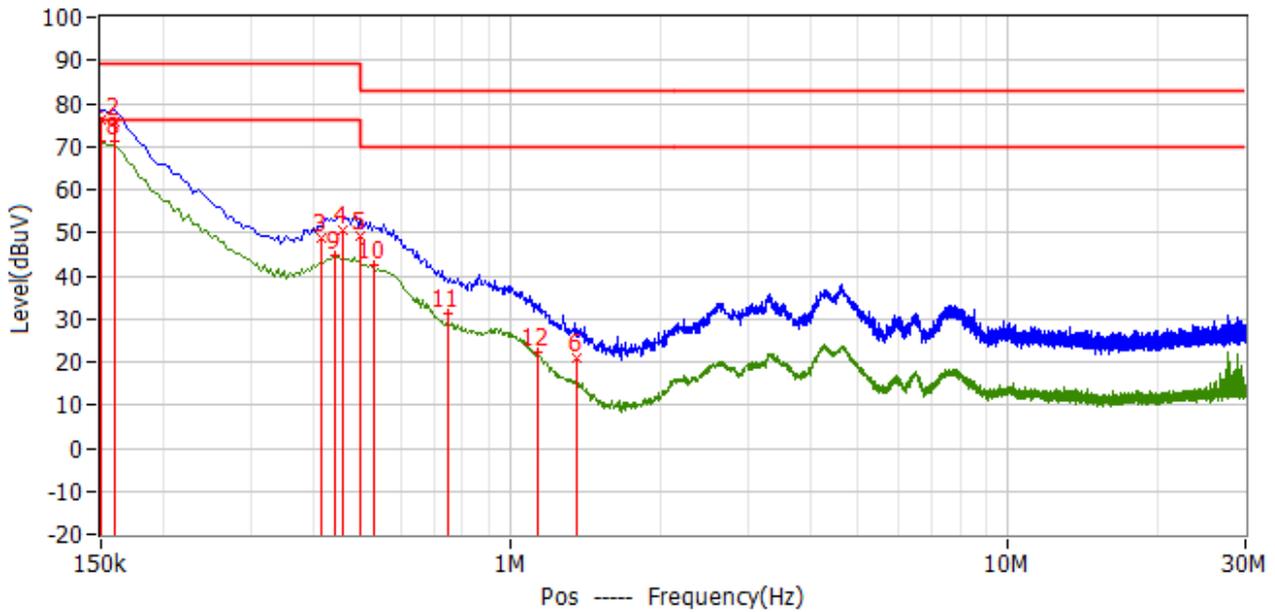


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Pole
1	150.000kHz	89.0	76.0	-13.0	54.8	21.2	QP	Pos
2	160.000kHz	89.0	75.7	-13.3	54.4	21.3	QP	Pos
3	415.000kHz	89.0	48.9	-40.1	27.6	21.3	QP	Pos
4	460.000kHz	89.0	50.6	-38.4	29.3	21.3	QP	Pos
5	500.000kHz	83.0	49.2	-33.8	27.9	21.3	QP	Pos
6	1.360MHz	83.0	21.0	-62.0	0.2	20.8	QP	Pos
7	150.000kHz	76.0	71.3	-4.7	50.1	21.2	AV	Pos
8	160.000kHz	76.0	71.1	-4.9	49.8	21.3	AV	Pos
9	445.000kHz	76.0	44.5	-31.5	23.2	21.3	AV	Pos
10	530.000kHz	70.0	42.5	-27.5	21.2	21.3	AV	Pos
11	750.000kHz	70.0	31.2	-38.8	10.2	21.0	AV	Pos
12	1.135MHz	70.0	22.2	-47.8	1.3	20.9	AV	Pos



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 1  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: DC -

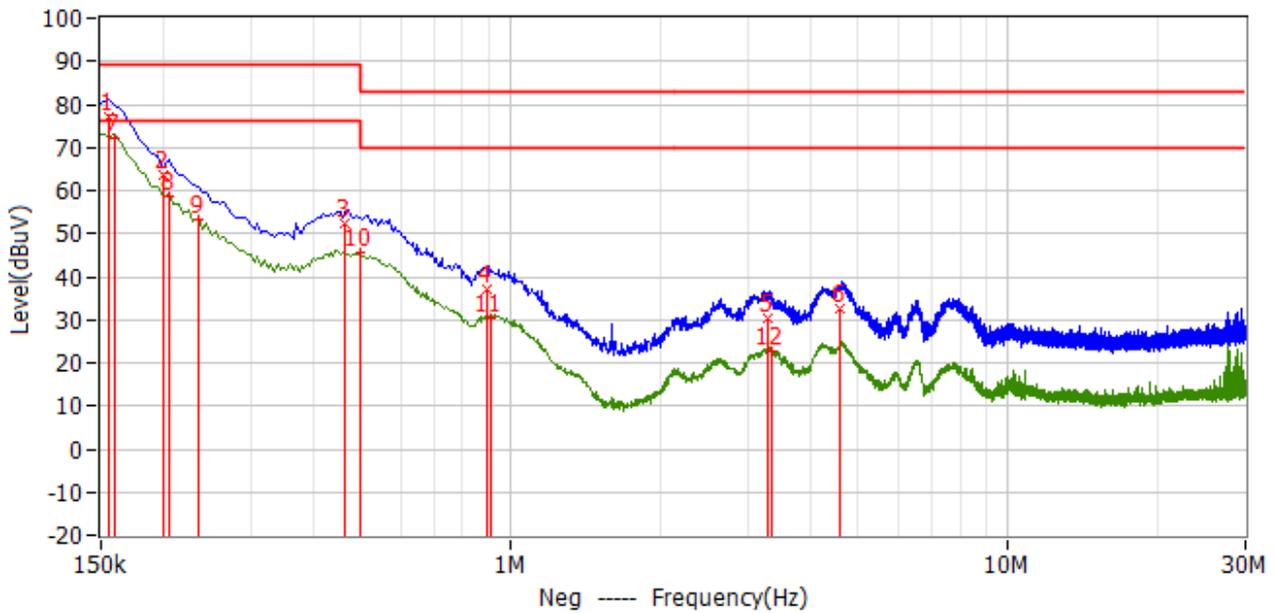


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Pole
1	155.000kHz	89.0	77.2	-11.8	55.8	21.4	QP	Neg
2	200.000kHz	89.0	63.4	-25.6	42.1	21.3	QP	Neg
3	465.000kHz	89.0	52.4	-36.6	31.0	21.4	QP	Neg
4	895.000kHz	83.0	37.1	-45.9	16.0	21.1	QP	Neg
5	3.285MHz	83.0	30.2	-52.8	9.1	21.1	QP	Neg
6	4.600MHz	83.0	32.7	-50.3	11.3	21.4	QP	Neg
7	160.000kHz	76.0	72.3	-3.7	50.9	21.4	AV	Neg
8	205.000kHz	76.0	58.8	-17.2	37.4	21.4	AV	Neg
9	235.000kHz	76.0	53.4	-22.6	32.0	21.4	AV	Neg
10	500.000kHz	70.0	45.4	-24.6	24.0	21.4	AV	Neg
11	915.000kHz	70.0	30.5	-39.5	9.4	21.1	AV	Neg
12	3.345MHz	70.0	22.7	-47.3	1.6	21.1	AV	Neg



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 2  
 Operator Name: Jin Cai  
 Test Sandard: EN IEC 61000-6-4  
 Comment: DC+

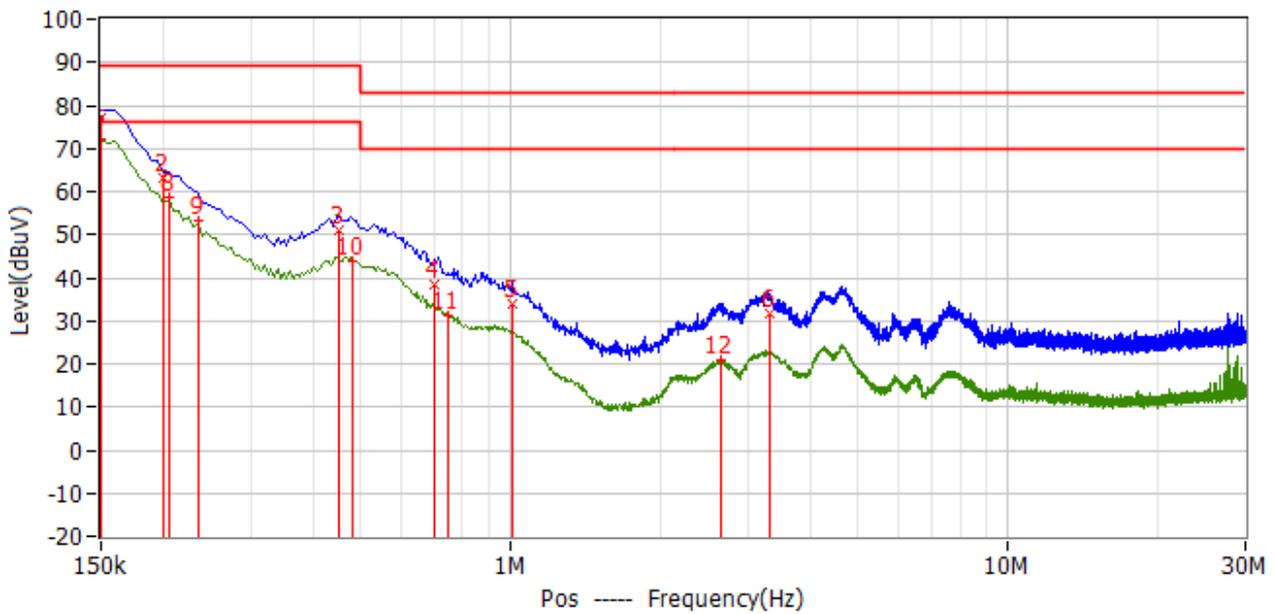


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Pole
1	150.000kHz	89.0	76.9	-12.1	55.7	21.2	QP	Pos
2	200.000kHz	89.0	63.1	-25.9	41.8	21.3	QP	Pos
3	450.000kHz	89.0	51.2	-37.8	29.9	21.3	QP	Pos
4	705.000kHz	83.0	38.3	-44.7	17.3	21.0	QP	Pos
5	1.010MHz	83.0	33.9	-49.1	13.0	20.9	QP	Pos
6	3.325MHz	83.0	31.5	-51.5	10.4	21.1	QP	Pos
7	150.000kHz	76.0	72.1	-3.9	50.9	21.2	AV	Pos
8	205.000kHz	76.0	58.6	-17.4	37.2	21.4	AV	Pos
9	235.000kHz	76.0	53.2	-22.8	31.8	21.4	AV	Pos
10	480.000kHz	76.0	43.8	-32.2	22.5	21.3	AV	Pos
11	750.000kHz	70.0	31.2	-38.8	10.2	21.0	AV	Pos
12	2.650MHz	70.0	21.1	-48.9	0.1	21.0	AV	Pos



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 2  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: DC -

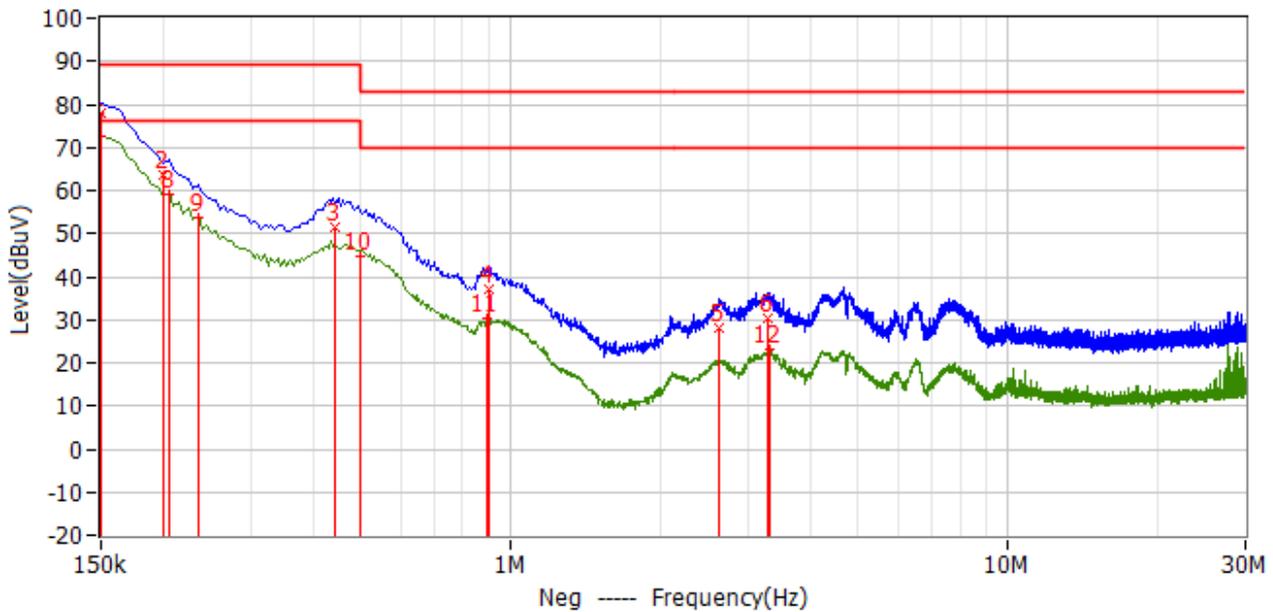


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Pole
1	150.000kHz	89.0	77.8	-11.2	56.6	21.2	QP	Neg
2	200.000kHz	89.0	63.4	-25.6	42.1	21.3	QP	Neg
3	445.000kHz	89.0	51.6	-37.4	30.2	21.4	QP	Neg
4	900.000kHz	83.0	36.9	-46.1	15.8	21.1	QP	Neg
5	2.615MHz	83.0	28.3	-54.7	7.3	21.0	QP	Neg
6	3.280MHz	83.0	30.4	-52.6	9.3	21.1	QP	Neg
7	150.000kHz	76.0	72.7	-3.3	51.5	21.2	AV	Neg
8	205.000kHz	76.0	58.9	-17.1	37.5	21.4	AV	Neg
9	235.000kHz	76.0	53.5	-22.5	32.1	21.4	AV	Neg
10	500.000kHz	70.0	44.9	-25.1	23.5	21.4	AV	Neg
11	895.000kHz	70.0	30.5	-39.5	9.4	21.1	AV	Neg
12	3.325MHz	70.0	23.1	-46.9	2.0	21.1	AV	Neg



## EUT Information

Test Description:	0.15-30MHz Conducted Emission Test
Eut:	Energy Storage System
Model:	ECO-E64WX
Client:	Shanghai Elecnova Energy Storage Co., Ltd.
Operating Conditions:	Power on, Mode 1
Operator Name:	Jin Cai
Test Standard:	EN IEC 61000-6-4
Comment:	AC Auxiliary power port, Phase L

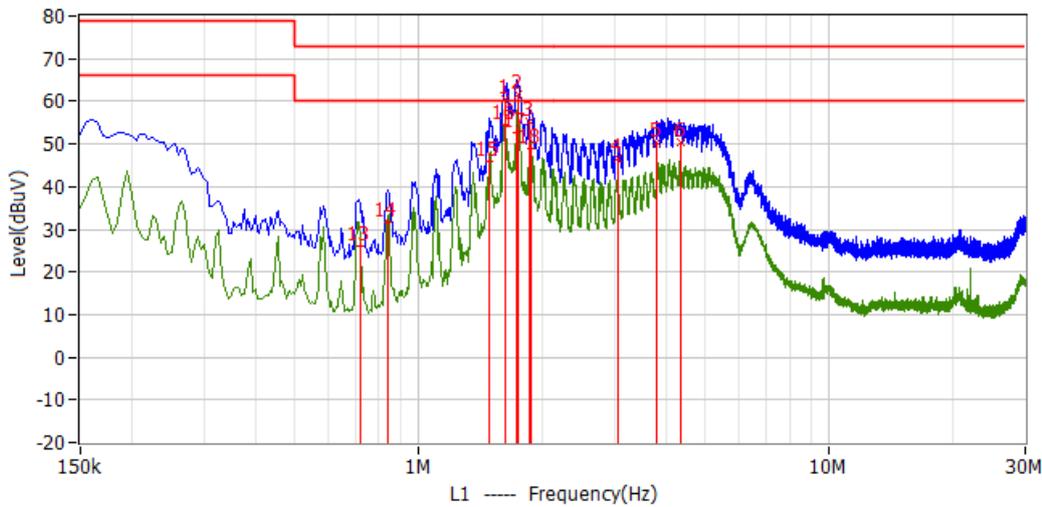


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Phase
1	1.625MHz	73.0	60.7	-12.3	41.2	19.5	QP	L1
2	1.740MHz	73.0	61.6	-11.4	42.1	19.5	QP	L1
3	1.860MHz	73.0	55.3	-17.7	35.8	19.5	QP	L1
4	3.050MHz	73.0	46.8	-26.2	27.2	19.6	QP	L1
5	3.800MHz	73.0	50.3	-22.7	30.6	19.7	QP	L1
6	4.335MHz	73.0	50.4	-22.6	30.6	19.8	QP	L1
13	720.000kHz	60.0	26.0	-34.0	6.3	19.7	CAV	L1
14	840.000kHz	60.0	31.8	-28.2	12.2	19.6	CAV	L1
15	1.485MHz	60.0	45.9	-14.1	26.4	19.5	CAV	L1
16	1.620MHz	60.0	54.6	-5.4	35.1	19.5	CAV	L1
17	1.730MHz	60.0	52.5	-7.5	33.0	19.5	CAV	L1
18	1.880MHz	60.0	48.8	-11.2	29.3	19.5	CAV	L1



## EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 1  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: AC Auxiliary power port, Phase N

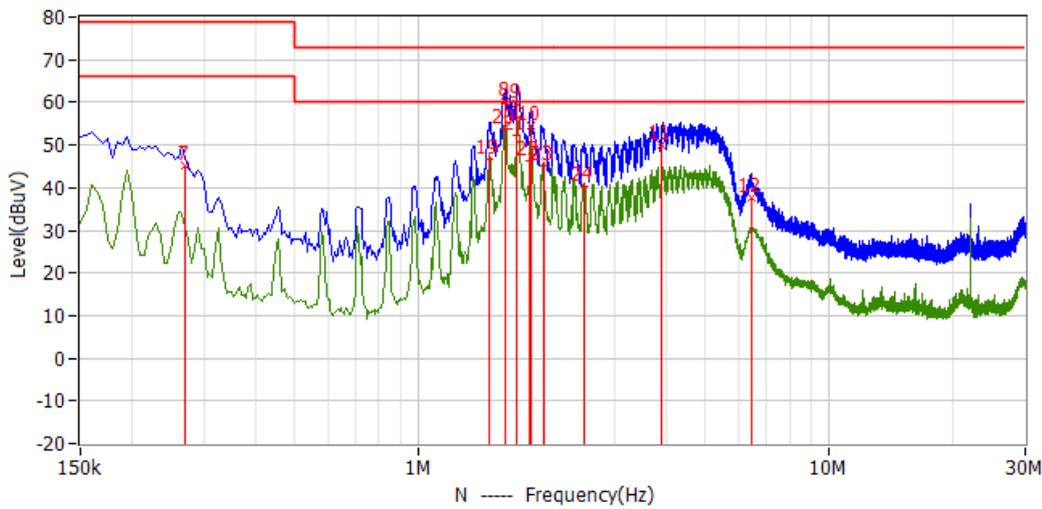


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Phase
7	270.000kHz	79.0	45.0	-34.0	25.4	19.6	QP	N
8	1.620MHz	73.0	60.1	-12.9	40.6	19.5	QP	N
9	1.725MHz	73.0	59.8	-13.2	40.3	19.5	QP	N
10	1.870MHz	73.0	54.4	-18.6	34.9	19.5	QP	N
11	3.915MHz	73.0	50.1	-22.9	30.4	19.7	QP	N
12	6.475MHz	73.0	37.7	-35.3	17.7	20.0	QP	N
19	1.490MHz	60.0	46.5	-13.5	27.0	19.5	CAV	N
20	1.625MHz	60.0	53.7	-6.3	34.2	19.5	CAV	N
21	1.730MHz	60.0	52.1	-7.9	32.6	19.5	CAV	N
22	1.860MHz	60.0	46.3	-13.7	26.8	19.5	CAV	N
23	2.010MHz	60.0	45.1	-14.9	25.6	19.5	CAV	N
24	2.530MHz	60.0	40.3	-19.7	20.8	19.5	CAV	N



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 2  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: AC Auxiliary power port, Phase L

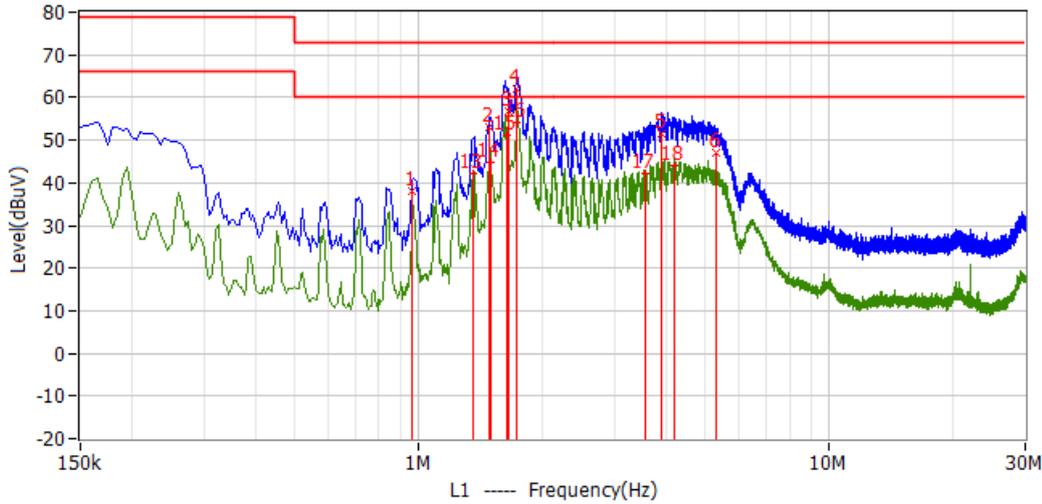


No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Phase
1	965.000kHz	73.0	38.1	-34.9	18.5	19.6	QP	L1
2	1.490MHz	73.0	52.9	-20.1	33.4	19.5	QP	L1
3	1.650MHz	73.0	56.9	-16.1	37.4	19.5	QP	L1
4	1.730MHz	73.0	61.9	-11.1	42.4	19.5	QP	L1
5	3.910MHz	73.0	51.4	-21.6	31.7	19.7	QP	L1
6	5.285MHz	73.0	47.2	-25.8	27.3	19.9	QP	L1
13	1.360MHz	60.0	42.3	-17.7	22.8	19.5	CAV	L1
14	1.500MHz	60.0	44.7	-15.3	25.2	19.5	CAV	L1
15	1.635MHz	60.0	51.1	-8.9	31.6	19.5	CAV	L1
16	1.735MHz	60.0	54.2	-5.8	34.7	19.5	CAV	L1
17	3.565MHz	60.0	42.3	-17.7	22.6	19.7	CAV	L1
18	4.200MHz	60.0	44.1	-15.9	24.3	19.8	CAV	L1



### EUT Information

Test Description: 0.15-30MHz Conducted Emission Test  
 Eut: Energy Storage System  
 Model: ECO-E64WX  
 Client: Shanghai Elecnova Energy Storage Co., Ltd.  
 Operating Conditions: Power on, Mode 2  
 Operator Name: Jin Cai  
 Test Standard: EN IEC 61000-6-4  
 Comment: AC Auxiliary power port, Phase N

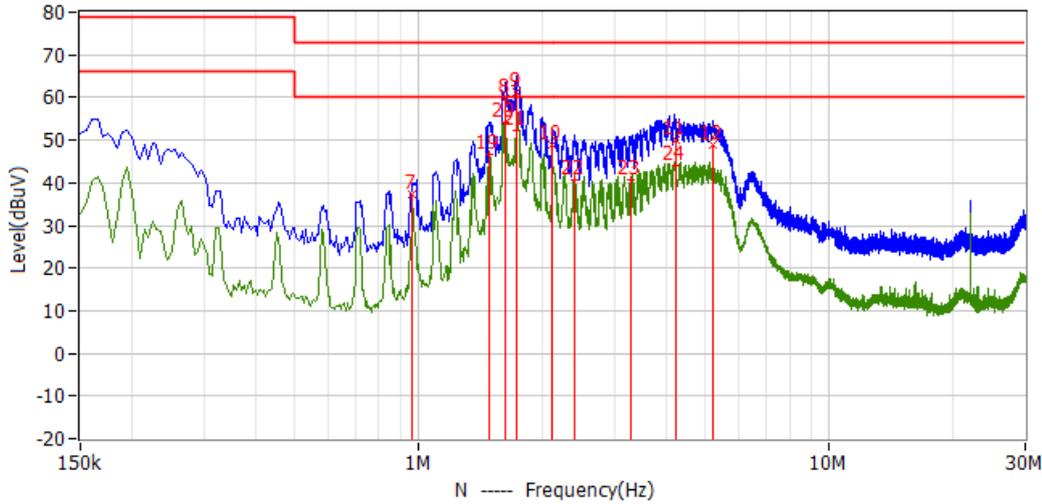

No.	Frequency	Limit dBuV	Level dBuV	Delta dB	Reading dBuV	Factor dB	Detector	Phase
7	965.000kHz	73.0	37.3	-35.7	17.7	19.6	QP	N
8	1.630MHz	73.0	59.6	-13.4	40.1	19.5	QP	N
9	1.730MHz	73.0	61.4	-11.6	41.9	19.5	QP	N
10	2.115MHz	73.0	49.0	-24.0	29.5	19.5	QP	N
11	4.220MHz	73.0	50.1	-22.9	30.3	19.8	QP	N
12	5.200MHz	73.0	48.8	-24.2	28.9	19.9	QP	N
19	1.490MHz	60.0	46.5	-13.5	27.0	19.5	CAV	N
20	1.620MHz	60.0	54.1	-5.9	34.6	19.5	CAV	N
21	1.730MHz	60.0	52.4	-7.6	32.9	19.5	CAV	N
22	2.400MHz	60.0	40.8	-19.2	21.3	19.5	CAV	N
23	3.300MHz	60.0	40.5	-19.5	20.9	19.6	CAV	N
24	4.215MHz	60.0	43.9	-16.1	24.1	19.8	CAV	N



**Test Setup**

## 2.2.8 Test Location

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

**2.3 Immunity - Enclosure port - Electrostatic discharge**

**2.3.1 Specification Reference**

EN IEC 61000-6-2:2019, Clause 9 Table 1, 1.4,

**2.3.2 Equipment Under Test**

ECO-E64WX

**2.3.3 Date of Test**


2024.12.12

**2.3.4 Test Method**

The equipment under test including associated cabling was configured on but insulated from, using a 0.5mm isolator, a horizontal coupling plane fitted to the top of a 0.8 m non-conductive table for table-top equipment; and on a 0.1 m insulated support for floor standing equipment; above a ground reference plane all within a test laboratory.

Using the air discharge method for non-metallic parts, contact discharge method for metallic parts with both vertical and horizontal couple plane discharge methods for the sides of the equipment under test, the required electrostatic discharge voltage levels in both voltage polarities were applied at the detailed pulse repartition rate.

During this testing any anomalies in the equipment under tests performance was recorded.

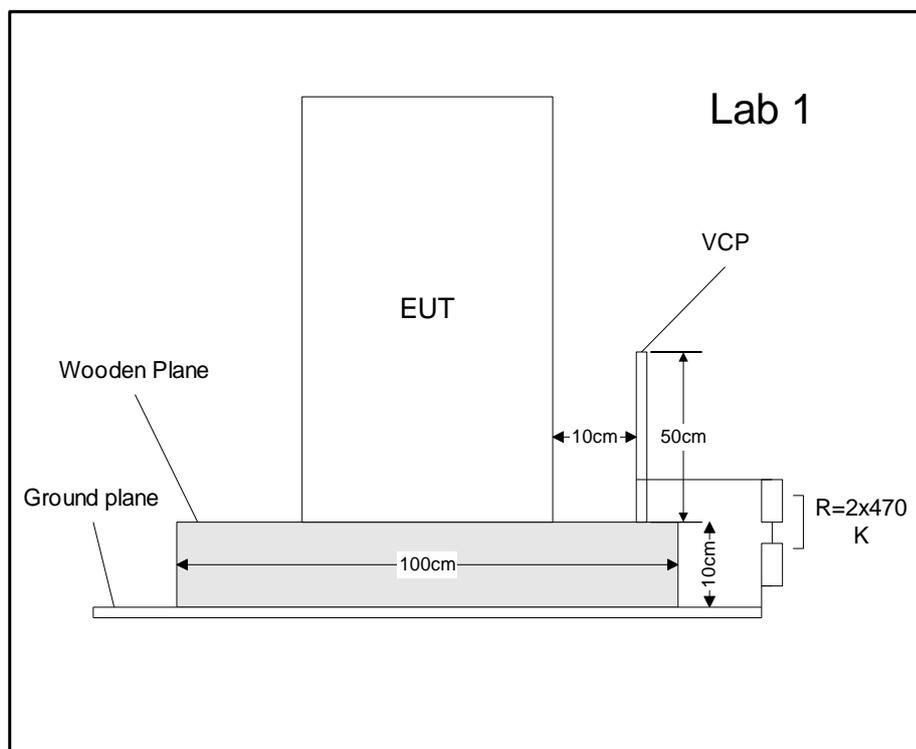



**2.3.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.3.6 Specification Limits**

Environmental phenomena		Test specifications	Units	Remarks	Performance criteria
Electrostatic discharge	Contact discharge	±4 (charge voltage)	kV	-	B
	Air discharge	±8 (charge voltage)	kV	-	B

**2.3.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1, 2.

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

ID	Test Point	Discharge	Results: Pass PC A									
			2kV		4kV		6kV		8kV		15kV	
			+	-	+	-	+	-	+	-	+	-
1	VCP	Contact	✓	✓	✓	✓						
2	Metal Enclosure, Metal screws	Contact	✓	✓	✓	✓						
3	Gaps, Buttons,	Air	✓	✓	✓	✓			✓	✓		

Key to Results	
✓	The EUTs performance was not impacted when the ESD pulse was applied.
✓*	No discharge occurred at this point when the ESD pulse was applied
O1	Observation
Fx	Failed
N/A	Not Applicable



**Test setup**

### **2.3.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

## 2.4 Immunity - Enclosure port - Radio-frequency electromagnetic field. Amplitude modulated

### 2.4.1 Specification Reference

EN IEC 61000-6-2:2019, Clause 9 Table 1, 1.2, 1.3

### 2.4.2 Equipment Under Test

ECO-E64WX

### 2.4.3 Date of Test


2024.12.12

### 2.4.4 Test Method

The equipment under test including associated cabling was configured, on a 0.8 m non-conductive table for table-top equipment and on a 0.1 m insulated support for floor standing equipment; with a pre-calibrated semi anechoic chamber.

All four side of the equipment under test were subjected to the required RF field strength, modulated as described, swept over the frequency range of test with the antenna positioned in both horizontal and vertical polarizations.

During this testing any anomalies in the equipment under tests performance was recorded.

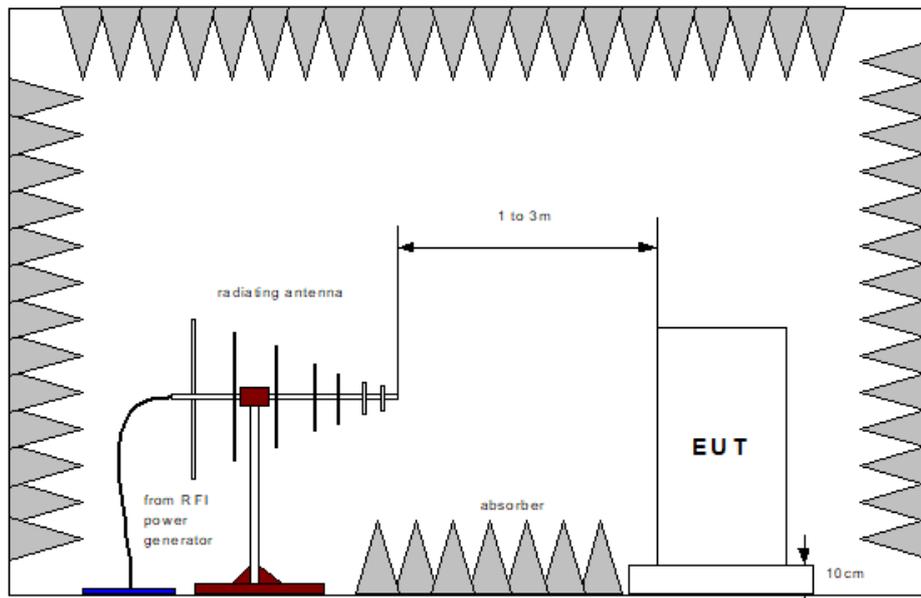



**2.4.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.4.6 Specification Limits**

Environmental phenomena	Test specifications	Units	Remarks	Performance criteria
Radio-frequency electromagnetic field. Amplitude modulated	80 to 1000 10 80	MHz V/m % AM (1 kHz)	The frequency range has been selected to cover the frequencies with the highest potential risk of disturbance.	A
Radio-frequency electromagnetic field. Amplitude modulated	1.4 to 6.0 3 80	GHz V/m % AM (1 kHz)	The frequency range has been selected to cover the frequencies with the highest potential risk of disturbance.	A
Supplementary information: Note: The test level specified is the r.m.s. value of the unmodulated carrier.				


**2.4.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1, 2.

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for RF Electromagnetic Field				
Step Size		1%		
Dwell Time		3 s		
Modulation		1kHz sine 80% AM		
Frequency Range	Test Face	Antenna Polarization	Test Level (V/m)	Result
80 MHz to 1 GHz	Front	Horizontal and Vertical	10 V/m	Pass PC A
80 MHz to 1 GHz	Rear	Horizontal and Vertical	10 V/m	Pass PC A
80 MHz to 1 GHz	Left	Horizontal and Vertical	10 V/m	Pass PC A
80 MHz to 1 GHz	Right	Horizontal and Vertical	10 V/m	Pass PC A
1.4 GHz to 6 GHz	Front	Horizontal and Vertical	3 V/m	Pass PC A
1.4 GHz to 6 GHz	Rear	Horizontal and Vertical	3 V/m	Pass PC A
1.4 GHz to 6 GHz	Left	Horizontal and Vertical	3 V/m	Pass PC A
1.4 GHz to 6 GHz	Right	Horizontal and Vertical	3 V/m	Pass PC A

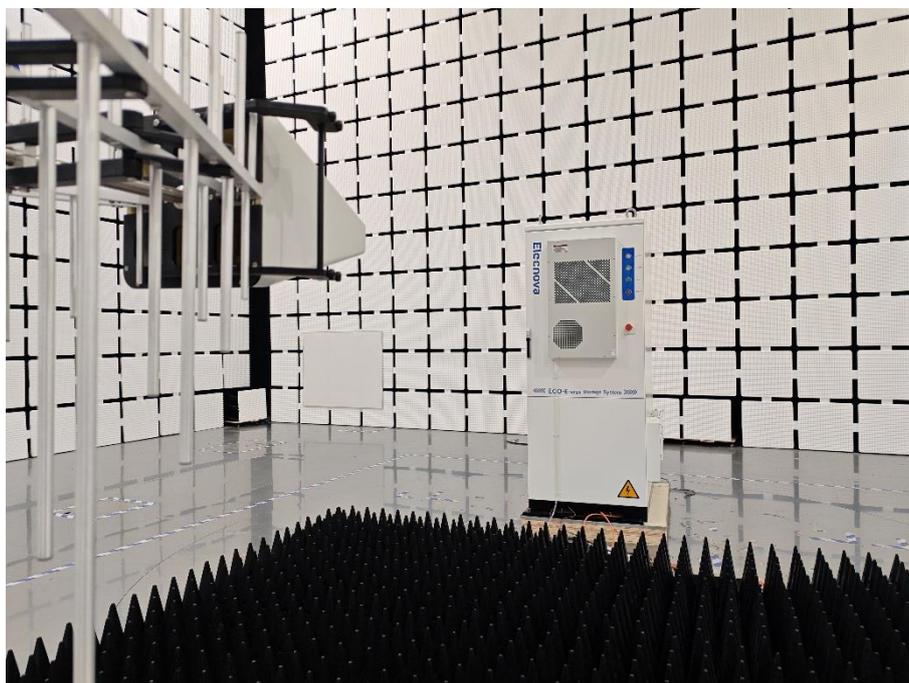

### Test Setup

#### 2.4.8 Test Location

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

**2.5 Immunity - Enclosure port - Power-frequency magnetic field**

**2.5.1 Specification Reference**

EN IEC 61000-6-2:2019, Clause 9 Table 1, 1.1

**2.5.2 Equipment Under Test**

ECO-E64WX

**2.5.3 Date of Test**


2024.12.12

**2.5.4 Test Method**

The equipment under test including associated cabling was configured on a non-conductive support at the volumetric center of the immunity coils. A pre calibrated input level was then applied to magnetic immunity coils at the detailed frequency and level for the required test period.

The EUT was retested with the magnetic field applied in all 3 orthogonal planes of the EUT.

During this testing any anomalies in the equipment under tests performance was recorded.

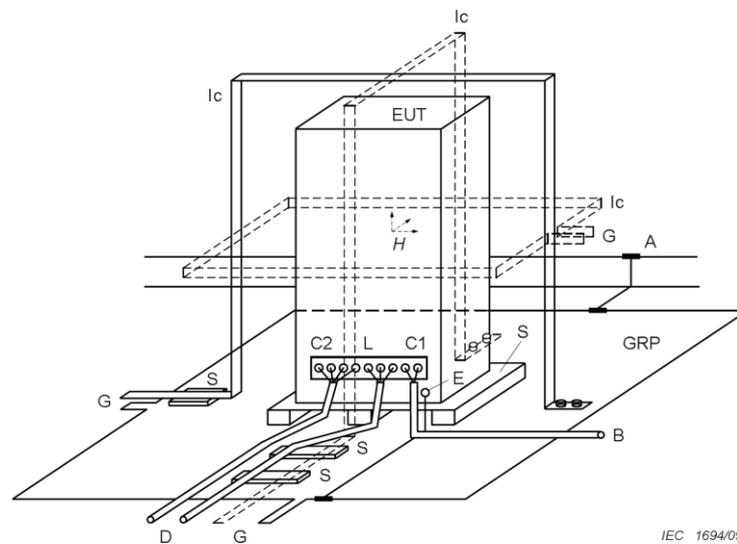

**Components**

- |     |                      |    |                             |
|-----|----------------------|----|-----------------------------|
| GRP | Ground plane         | C1 | Power supply circuit        |
| A   | Safety earth         | C2 | Signal circuit              |
| S   | Insulating support   | L  | Communication line          |
| EUT | Equipment under test | B  | To power supply source      |
| Ic  | Inductive coil       | D  | To signal source, simulator |
| E   | Earth terminal       | G  | To the test generator       |

**Figure 5 – Example of test set-up for floor-standing equipment**



**2.5.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52%  
 Atmospheric Pressure 1012.5 mbar

**2.5.6 Specification Limits**

Environmental phenomena	Test specifications	Units	Remarks	Performance criteria
Power-frequency magnetic field	50, 60 30	Hz A/m	Applicable only to apparatus containing devices susceptible to magnetic fields.	A
Supplementary information: Note: The test shall be carried out at the frequencies appropriate to the power supply frequency. Equipment intended for use in areas supplied only at one of these frequencies need only be tested at that frequency.				

**2.5.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1, 2.

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for Power Frequency Magnetic Immunity					
Orientation	Operating Frequency	Test Frequency	Test Level	Duration	Result
X	50,60Hz	50,60Hz	30A/m	1 minutes	Pass PC A
Y	50,60Hz	50,60Hz	30A/m	1 minutes	Pass PC A
Z	50,60Hz	50,60Hz	30A/m	1 minutes	Pass PC A



**Test Setup**

### **2.5.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

## 2.6 Immunity - Fast transients

### 2.6.1 Specification Reference

EN IEC 61000-6-2:2019, Clause 9 Table 4, 4.5

### 2.6.2 Equipment Under Test

ECO-E64WX

### 2.6.3 Date of Test


2024.12.12

### 2.6.4 Test Method

The equipment under test including associated cabling was configured on but insulated from, using a 0.1 m isolator, a horizontal coupling plane fitted to the top of a 0.8 m non-conductive table for table-top equipment; and on a 0.1 m insulated support for floor standing equipment; above a ground reference plane all within a test laboratory.

Using a CDN for power ports, capacitive coupling clamp for signal and control ports and a 33 nF coupling capacitor for earth ports, the required fast transient burst voltage levels in both voltage polarities were applied at the detailed pulse repartition rate and duration of test.

During this testing any anomalies in the equipment under tests performance was recorded.

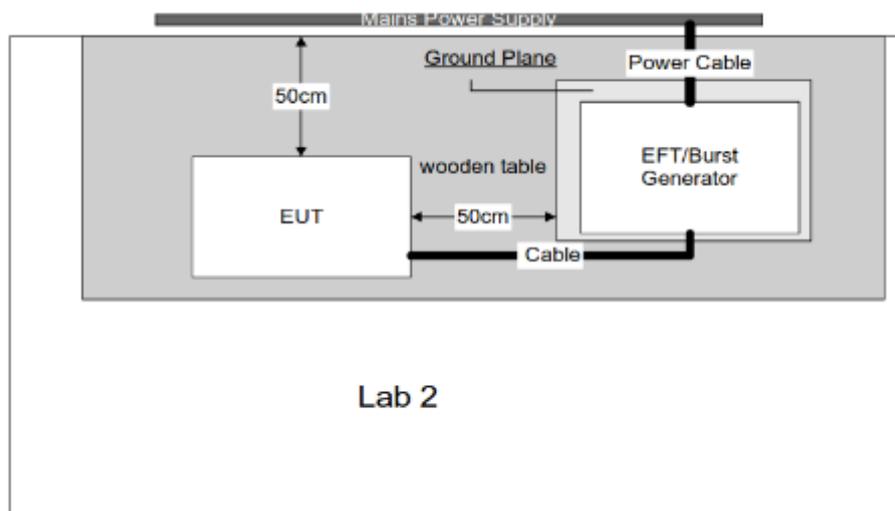



**2.6.5 Environmental Conditions**

Ambient Temperature 21.5 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.6.6 Specification Limits**

Environmental phenomena	Test specifications	Units	Remarks	Performance criteria
Fast transients (AC power ports)	±2 5/50 5 or 100	kV (open circuit test voltage) Tr/Th ns Repetition frequency kHz		B
Fast transients (DC power ports)	±1 5/50 5 or 100	kV (open circuit test voltage) Tr/Th ns Repetition frequency kHz		B
Supplementary information:				

**2.6.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1,2

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for Fast Transient Burst Immunity					
Line under test	Test Level (kV)	Repetition Rate	Test Duration	Coupling Method	Result
DC Main Power line	±1	5	120s	Clamp	Pass PC A
AC auxiliary Power line	±2	5	120s	CDN	Pass PC A



### Test Setup

#### 2.6.8 Test Location

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

**2.7 Immunity - Surges**

**2.7.1 Specification Reference**

EN IEC 61000-6-2:2019, Clause 9 Table 4, 4.4

**2.7.2 Equipment Under Test**

ECO-E64WX

**2.7.3 Date of Test**


2024.12.12

**2.7.4 Test Method**

The equipment under test including associated cabling was configured, on a 0.8 m non-conductive table for table-top equipment and on a 0.1 m insulated support for floor standing equipment above a ground reference plane all within a test laboratory.

Using CDNs for power ports and appropriate coupling methods for applicable signal and control ports, the required number of surges was applied for each surge voltage level using both positive and negative surge voltage polarities. Surges were applied at the power line frequency phase angles and repartition rates detailed.

During this testing any anomalies in the equipment under tests performance was recorded.

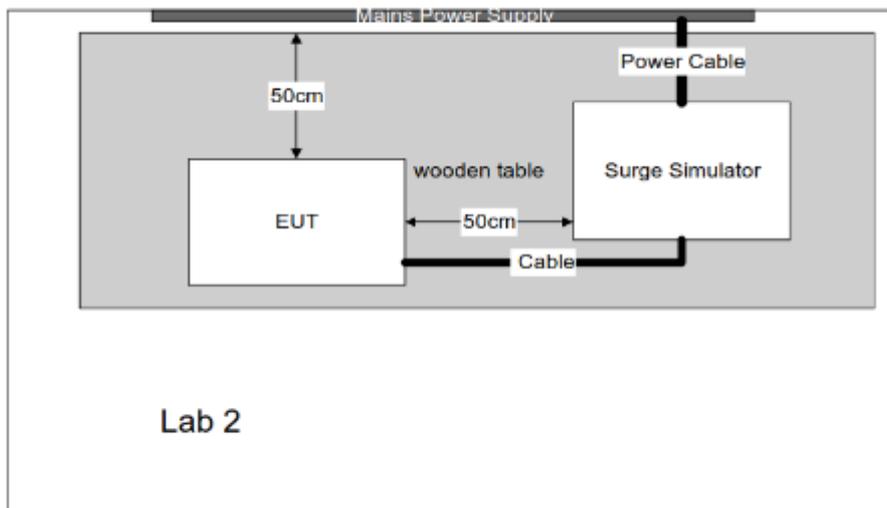



**2.7.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.7.6 Specification Limits**

Environmental phenomena	Test specifications	Units	Remarks	Performance criteria
Surges (DC power ports) line-to-earth line-to-line	1.2/50 (8/20) ±1 ±0.5	Tr/Th µs kV (open circuit test voltage) kV (open circuit test voltage)	-	B
Surges (AC power ports) line-to-earth line-to-line	.2/50 (8/20) ±2 ±1	Tr/Th µs kV (open circuit test voltage) kV (open circuit test voltage)		B
Supplementary information: According to the remark f in table 3 of EN IEC 61000-6-2:2019, the DC power port was excluded because of the specified AC-DC adapter was used, only the AC power input of AC-DC adapter should be tested.				

**2.7.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1, 2

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for Surge Immunity (Power Ports)							
Line under test	Coupling	Level	Polarity	Phase Angle	No of Pulses	Repetition Rate	Result
DC power line	DC+ - DC-	0.5kV	NEGATIVE POSITIVE	--	5	60	Pass PC A
DC power line	DC+/DC- -GND	1.0kV	NEGATIVE POSITIVE	--	5	60	Pass PC A
AC auxiliary power line	L-N	1.0kV	NEGATIVE POSITIVE	0,90,180,2 70	5	60	Pass PC A
AC auxiliary power line	L/N -GND	2.0kV	NEGATIVE POSITIVE	0,90,180,2 70	5	60	Pass PC A



**Test Setup**

### **2.7.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

**2.8 Immunity - Radio-frequency common mode**

**2.8.1 Specification Reference**

EN IEC 61000-6-2:2019, Clause 9 Table 4, 4.1

**2.8.2 Equipment Under Test**

ECO-E64WX

**2.8.3 Date of Test**

2024.12.12


**2.8.4 Test Method**

The equipment under test was configured, on but insulated from, using a 0.1 m isolator, a horizontal coupling plane fitted to the top of a 0.8 m non-conductive table for table-top equipment; and on a 0.1 m insulated support for floor standing equipment; above a ground reference plane all within a test laboratory.

All associated cabling was configured, on but insulated from, using a 50 mm isolator, the same horizontal coupling plane as the equipment under test.

Using CDNs, EM Clamps or current clamps as appropriate, the power ports and applicable signal and control ports were subjected to the required, pre calibrated RF injected signal strength, modulated as described, swept over the frequency range of test.

During this testing any anomalies in the equipment under tests performance was recorded.

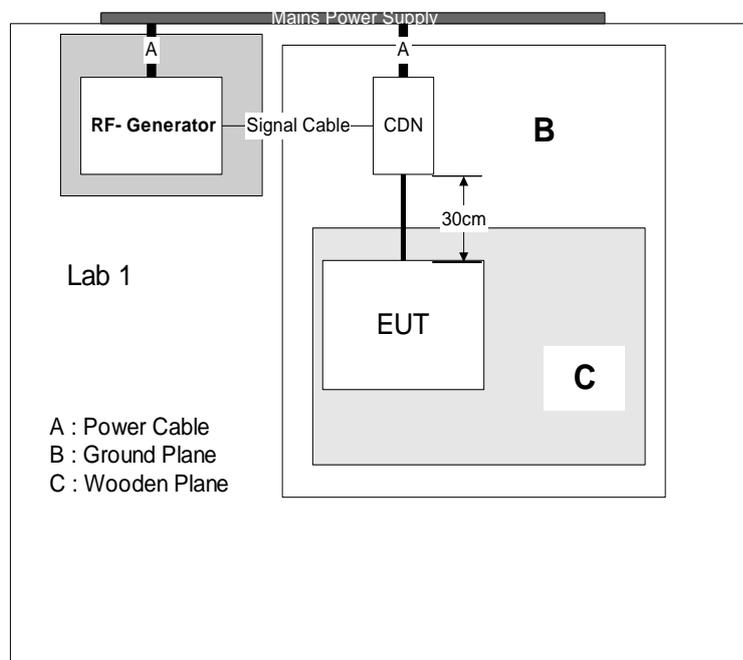



**2.8.5 Environmental Conditions**

Ambient Temperature 21.3 °C  
 Relative Humidity 52 %  
 Atmospheric Pressure 1012.5 mbar

**2.8.6 Specification Limits**

Environmental phenomena	Test specifications	Units	Remarks	Performance criteria
Radio-frequency common mode (DC power ports)	0.15 to 80 10 80	MHz V % AM (1 kHz)	The test level specified is the r.m.s. value of the unmodulated carrier. a*	A
Radio-frequency common mode (AC power ports)	0.15 to 80 10 80	MHz V % AM (1 kHz)	The test level specified is the r.m.s. value of the unmodulated carrier.	A
Supplementary information: a* : The test level can also be defined as the equivalent current into a 150 Ω load.				

**2.8.7 Test Results**

**Results for Configuration and Mode:** Configuration 1, Mode 1, 2

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for Conducted Radio Frequency Interference					
Modulation = 80 % AM (1 kHz)		Step Size = 1 %		Dwell = 3 s	
Line Under Test	Frequency Range	Test Level	Coupling Method	Interference Return Path	Result
DC power line	150kHz to 80MHz	10 V	CDN	CDN	Pass PC A
AC power line	150kHz to 80MHz	10 V	CDN	CDN	Pass PC A



**Test Setup**

### **2.8.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

## 2.9 Immunity - Voltage dips, short interruptions and voltage variations immunity tests

### 2.9.1 Specification Reference

EN IEC 61000-6-2:2019, Clause 9 Table 4, 4.2, 4.3

### 2.9.2 Equipment Under Test

ECO-E64WX


### 2.9.3 Date of Test

2024.12.12

### 2.9.4 Test Method

The equipment under test including associated cabling was configured, on a 0.8 m non-conductive table for table-top equipment and on a 0.1 m insulated support for floor standing equipment above a ground reference plane all within a test laboratory.

Using a programmable power supply the equipment under test was subjected to the detailed supply voltage dips and interruptions. The required supply phase synchronization and test repetition rate, detailed, was controlled by the programmable power supply. During this testing any anomalies in the equipment under tests performance was recorded.

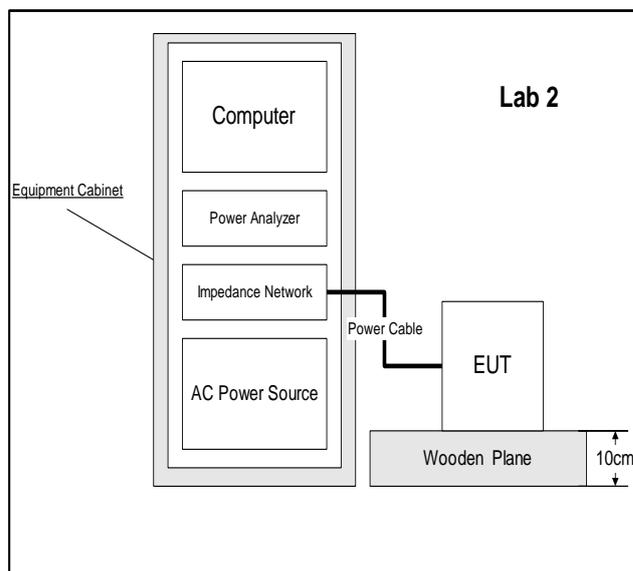

### 2.9.5 Environmental Conditions

Ambient Temperature	21.3 °C
Relative Humidity	52 %
Atmospheric Pressure	1012.5 mbar



**2.9.6 Specification Limits**

Voltage dips				
Voltage Dip in % Ut	Test level in % Ut	Duration		Performance Criteria
		50Hz	60Hz	
100	0	1 cycle	1 cycle	B
60	40	10 cycles	12 cycles	C
30	70	25 cycles	30 cycles	C
Ut is the rated voltage of the Equipment Under Test				

Voltage interruptions				
Voltage interruptions in % Ut	Test level in % Ut	Duration		Performance Criteria
		50Hz	60Hz	
100	0	250 cycles	300 cycles	C

**2.9.7 Test Results**

Results for Configuration and Mode: Configuration 1, Mode 1,2.

Performance assessment of the EUT made during this test: Pass.

Detailed results are shown below.

Tabulated Results for Voltage Dip and Short Interruption					
Line under test	Vnom	Operating Frequency	Test Level	Duration	Result
AC auxiliary Power line	230Vac,	50, 60Hz	0% of Vnom	1cycle	Pass PC A
AC auxiliary Power line	230Vac,	50, 60Hz	40% of Vnom	10 cycles (50Hz) 12 cycles (60Hz)	Pass PC A
AC auxiliary Power line	230Vac,	50, 60Hz	70% of Vnom	25 cycles (50Hz) 30 cycles (60Hz)	Pass PC A
AC auxiliary Power line	230Vac,	50, 60Hz	0% of Vnom	250 cycles (50Hz) 300 cycles (60Hz)	Pass PC C

Result Description	
C	During the test, the EUT would be shut down and after removing the interference it can restore its normal mode by manual operation.



**Test Setup**

### **2.9.8 Test Location**

This test was carried out in Suzhou Institute of Product Quality Supervision and Inspection.

### 3 Test Equipment Information

#### 3.1 General Test Equipment Used

Instrument	Manufacturer	Type No	TE No	Calibration Date	Calibration Due
Emission					
EMI Test Receiver	Rohde & Schwarz	ESR 7	SZZJ-501-996-01	2024.07.10	2025.07.09
Log periodic antenna	Schwarzbeck	VULB 9168	SZZJ-501-996-04	2024.06.26	2025.06.25
10 m semi anechoic chamber	SKET	AC-10m	SZZJ-501-1138	2023.7.02	2028.07.01
EMI Test Receiver	Rohde & Schwarz	ESR 7	SZZJ-501-997-02	2024.07.10	2025.07.09
High voltage artificial power network	Schwarzbeck	NNHV 8123-800	SZZJ-510-045	2024.02.18	2025.02.17
High voltage artificial power network	Schwarzbeck	NNHV 8123-800	SZZJ-510-046	2024.02.18	2025.02.17
Artificial power network	Rohde & Schwarz	ENV 216	SZZJ-501-997-03	2024.06.27	2025.06.26
CE Test software		EMC-I(V 1.5.0.7)			
RE Test software		EMC-I(V 1.5.0.7)			

Immunity					
ESD simulator	3C TEST	EDS30V	SZZJ-501-989-01	2024.02.21	2025.02.20
Electric fast transient pulse group simulator	3C TEST	EFT 800T	SZZJ-501-989-07	2024.02.18	2025.02.17
Capacitive coupling clamp	3C TEST	CCC 100	SZZJ-501-989-03	2024.02.29	2025.02.28
Surge generator	3C TEST	CWS 600G	SZZJ-501-989-10	2024.02.18	2025.02.17
High-voltage and high-power combined coupling decoupling network	3C TEST	SPN 15200T	SZZJ-501-989-09	2024.02.18	2025.02.17
Radio frequency conduction immunity test system	3C TEST	CST1075E	SZZJ-501-989-04	2024.02.29	2025.02.28
Coupling decoupling network	3C TEST	CDNM2M3	SZZJ-501-989-15	2024.02.18	2025.02.17
Electromagnetic clamp	3C TEST	EMCL100	SZZJ-501-989-17	2024.02.29	2025.02.28
attenuator	3C TEST	AT80-6dB-1G-NF-NF-A	SZZJ-501-989-32	2024.07.10	2025.07.09
Signal Generator	Rohde & Schwarz	SMB100B	SZZJ-501-999-01	2024.07.10	2025.07.09
Power Amplifier	Rflight	NTWPA-0081020001000E	SZZJ-501-1162	2024.07.10	2025.07.09
Power Amplifier	Rflight	NTWPA-1060200P	SZZJ-501-999-05	2024.07.10	2025.07.09
power meter	Rohde & Schwarz	NRX	SZZJ-501-999-02	2024.07.10	2025.07.09
Average power probe	Rohde & Schwarz	NRP6A	SZZJ-501-999-03	2024.07.10	2025.07.09
Average power probe	Rohde & Schwarz	NRP6A	SZZJ-501-999-14	2024.07.10	2025.07.09
Log Periodic Antenna	Schwarzbeck	STLP 9129	SZZJ-501-999-06	—	—
Power failure simulator	3C test	PFS 2216SVD	SZZJ-501-989-08	2024.02.18	2025.02.17
Power frequency magnetic field generator	3C test	MFS 1200	SZZJ-501-989-25	2025.02.29	2025.02.28
Power frequency magnetic field module	3C test	MFT1200	SZZJ-501-989-29	2025.02.29	2025.02.28
Power frequency coil	3C test	TCXS113	SZZJ-501-989-28	2025.02.29	2025.02.28



## 4 Measurement Uncertainty

For a 95% confidence level, the measurement uncertainties for defined systems are:

Test Name	Measurement Uncertainty
Emission - Conducted Disturbance	150 kHz to 30 MHz, LISN, 2.3dB
Emission - Enclosure port	30 MHz to 1 GHz, 4.9dB
Immunity - Enclosure port - Electrostatic discharge	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-2
Immunity - Enclosure port - Radio-frequency electromagnetic field. Amplitude modulated	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-3
Immunity - Fast transients	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-4
Immunity - Surges	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-5
Immunity - Radio-frequency common mode	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-6
Immunity - Power-frequency magnetic- field	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-8
Immunity - Voltage dips	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-11
Immunity - Voltage interruptions	The test was applied using proprietary equipment that meets the requirements of EN 61000-4-11

### Measurement Uncertainty Decision Rule

Determination of conformity with the specification limits is based on the decision rule according to IEC Guide 115: 2023, clause 4.3.3.

## 5 Photographs

Model: ECO-E64WX




















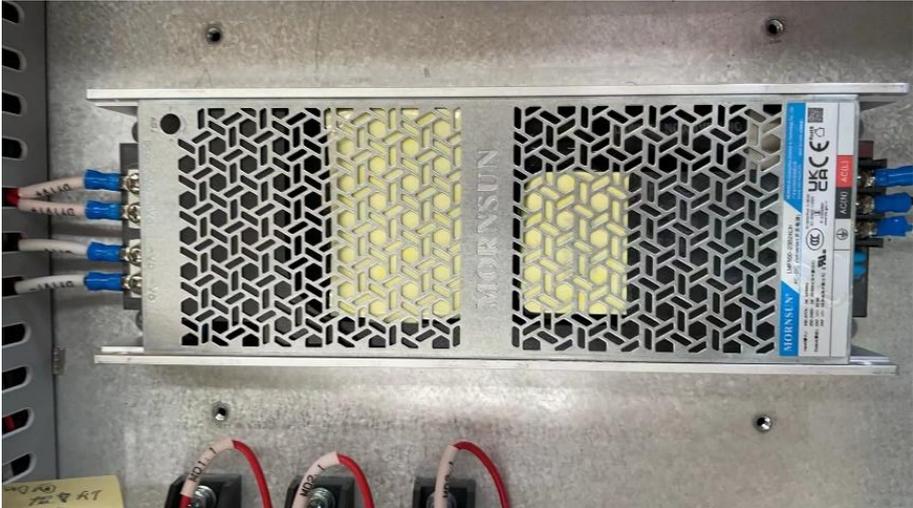


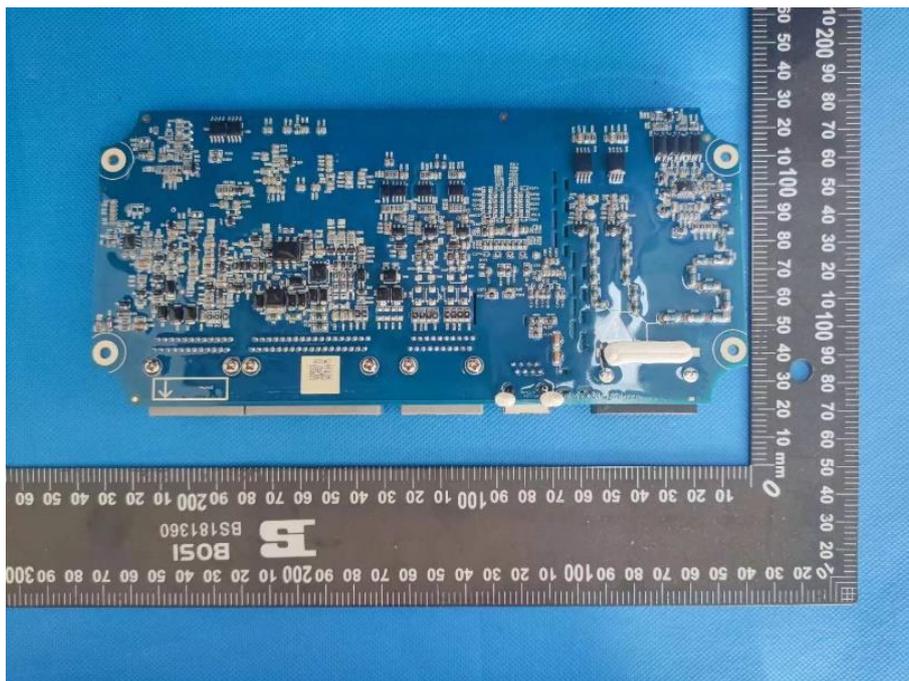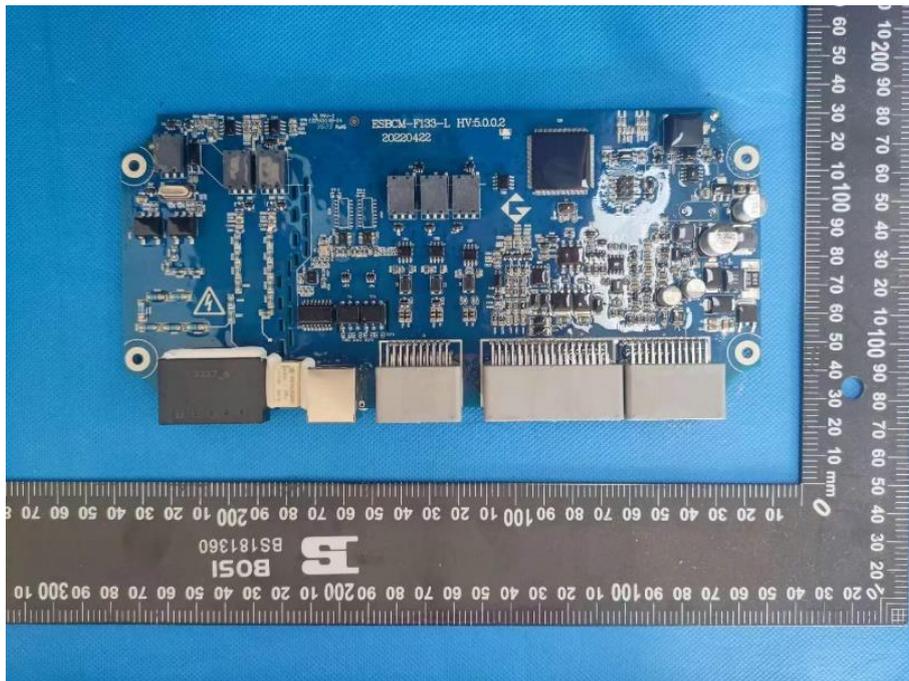



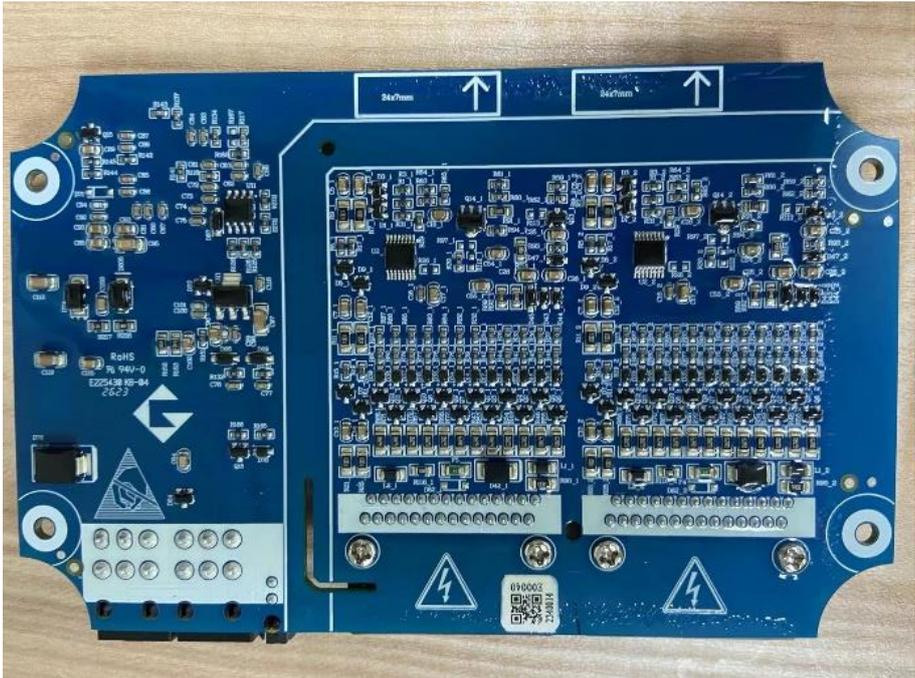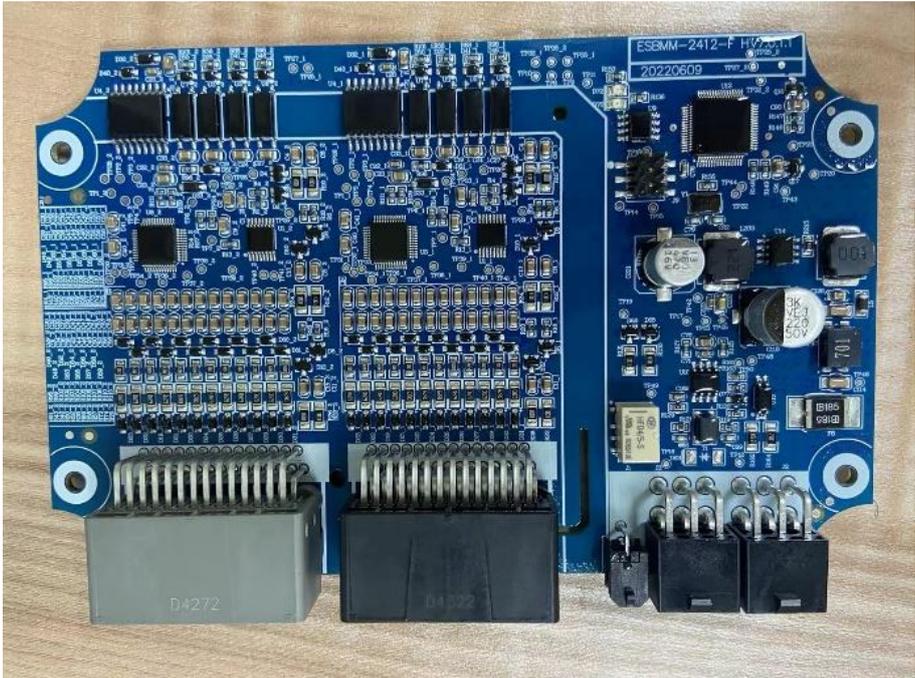



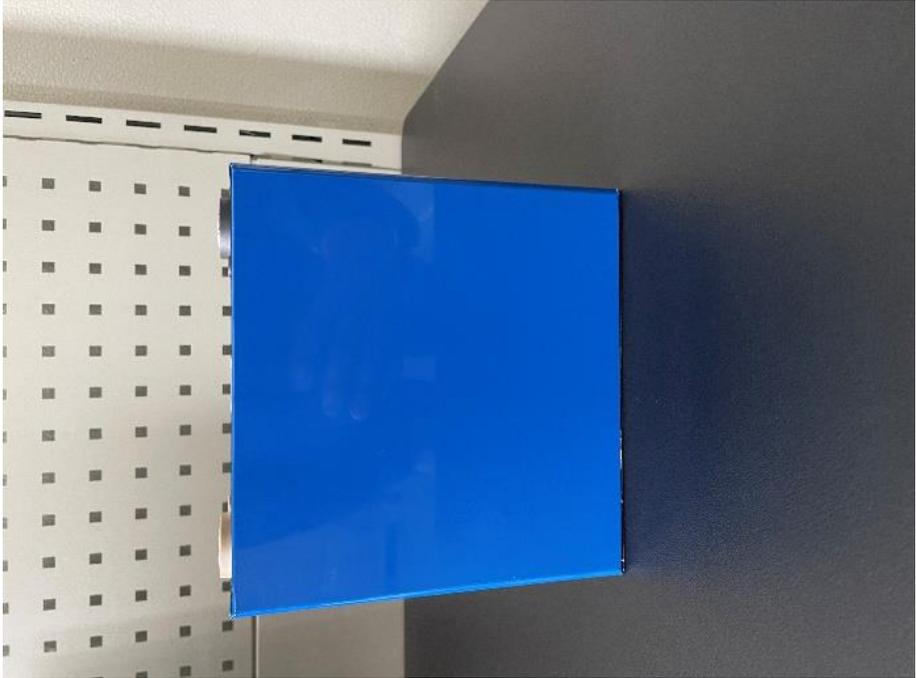

-----This is the end page of the report-----